


LEGEND

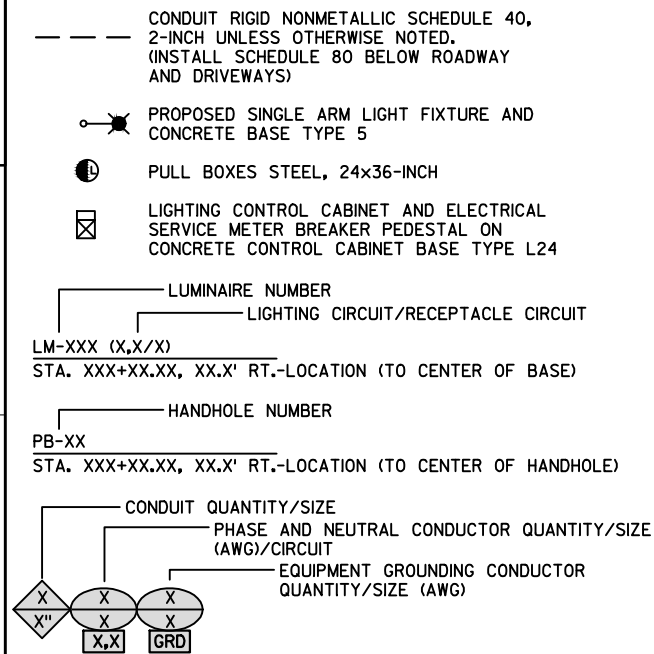

GENERAL NOTES:
PROVIDE NEUTRAL WIRE AT EVERY LIGHT POLE TO SERVE 120V RECEPTACLE.

RECEPTACLES TO BE MOUNTED AT 16'-0 TO BOTTOM OF RECEPTACLE.
MEASURED FROM BOTTOM OF POLE, NOT POLE BASE. RECEPTACLE SHALL BE
FACTORY PROVIDED AND LOCATED SO THAT IT IS NOT VISIBLE TO ONCOMING
TRAFFIC.

CONDUIT SHALL BE PLACED 2 FEET BELOW GRADE AND RUN PARALLEL TO CURB
AND/OR ROADWAY.

STATION/OFFSET MEASURED TO CENTER OF CONCRETE BASE AND POLE.

ALL LIGHTING CONDUCTORS SHALL BE RUN IN CONDUIT RIGID NON-METALIC
SCHEDULE 40 2-INCH EXCEPT UNDER ROADWAY OR DRIVEWAY ENTRANCES,
WHERE SCHEDULE 80 SHALL BE USED.

LIGHT POLE HANDHOLES SHALL BE FACTORY PROVIDED AND LOCATED SO THEY
ARE ON THE OPPOSITE SIDE OF THE POLE FROM STREET.

LIGHT POLES SHALL BE FACTORY DRILLED FOR LUMINAIRE MOUNTING. PROVIDE
LUMINAIRE (SPV.0060.00) MOUNTING TEMPLATE TO FACTORY UPON PLACING ORDER.

